



- NOTES:
1. USE DETAIL IN CONJUNCTION WITH ALSAN FLASHING SPECIFICATIONS, APPLICATION INSTRUCTIONS, COVERAGES AND APPROVED DETAILS.
 2. "PROPERLY PREPARED SUBSTRATE" MEANS AN ACCEPTABLE, CLEAN, DRY SUBSTRATE WITH AN APPROVED SURFACE, AN ALSAN PRIMER APPLIED OVER SINGLE PLY, MULTIPLE PLY SMOOTH OR GRANULATED ASPHALT BUR (WHERE REQUIRED), DETAIL OR BASE COAT SURFACE (AFTER 7 DAYS) OR SURFACE WITHOUT GOOD ADHESION BOND TESTS.
 3. SPLITS, BLISTERS, FISH MOUTHS, EXISTING FLASHING, JOINTS AND SEAMS: APPLY ALSAN FLASHING DETAIL BASE COAT AT 1.5 GALS (24 WET MILS OR APPROX. 18 DRY MILS) TO 3.0 GALS (48 WET MILS OR APPROX. 36 DRY MILS) PER 100 FT² OR THAT ADDITIONAL AMOUNT OF MATERIAL TO INSURE REPAIR AREA, JOINTS OR SEAMS ARE WATERTIGHT. AMOUNT OF COATING DEPENDS ON TYPE OF DETAIL BEING COATED. EMBED ALSAN POLYFLEECE REINFORCEMENT INTO DETAIL COAT WITHOUT WRINKLES OR FOLDS FOLLOWED BY ADDITIONAL COATING TO INSURE WATERTIGHT SEAL.
 4. UNLESS OTHERWISE INDICATED, ALSAN FLASHING BASE COAT IS APPLIED IN ONE COAT AT A RATE OF 1.87 GALS/100 FT² OR APPROX. 30 WET MILS OR 22 DRY MILS PER 100 FT² TO INSURE 22 DRY MIL THICKNESS AT THE APEX OF THE ROOF SURFACE AND TO INSURE WATERTIGHTNESS.
 5. UNLESS OTHERWISE INDICATED, ALSAN FLASHING FINISH COAT IS APPLIED IN ONE COAT AT A RATE OF 1.87 GAL (30 WET MILS OR APPROX. 22 DRY MILS) PER 100 FT² OR THAT ADDITIONAL AMOUNT OF MATERIAL TO INSURE A 22 DRY MIL THICKNESS AT THE APEX OF THE ROOF SURFACE AND TO INSURE WATERTIGHTNESS. CURAL 24 WET MILS COVERAGE RATE (DRY 16 MILS) IS 1.5 GAL/100 FT.²

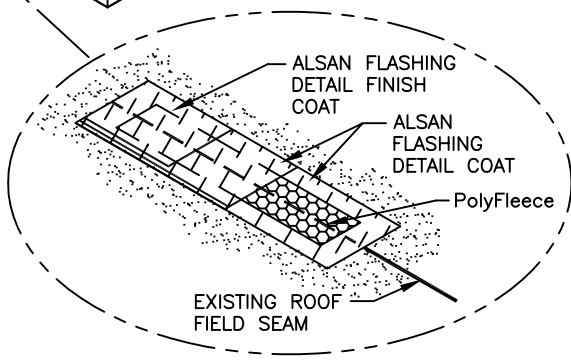

		310 QUADRAL DRIVE	
		WADSWORTH, OHIO 44281 (330) 334-0066	
TITLE ALSAN FLASHING RECOVER ROOF ASSEMBLY			
SCALE	DWN DMT	CHK PR	APPROVAL DATE 10/15/04
DRAWING NUMBER AFMA-002			REV 0

** USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.