



STEP #1

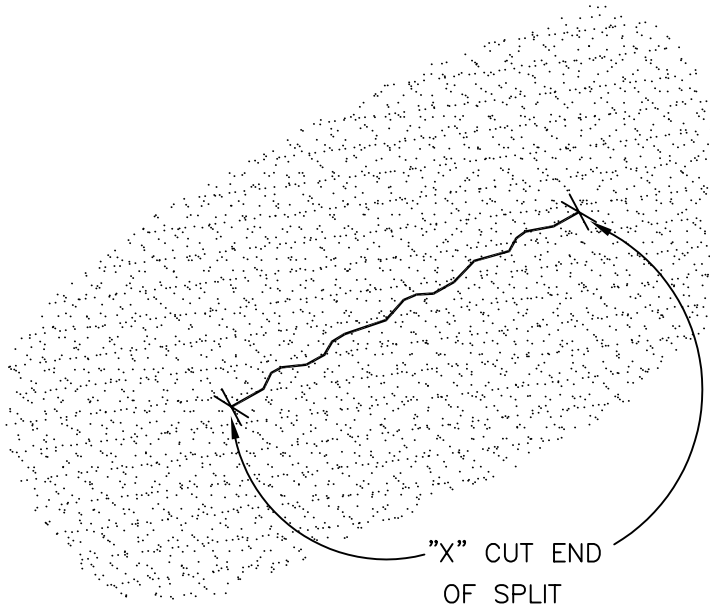


EXISTING BUR OR ASPHALT
MEMBRANE SPLIT OR PUNCTURE

STEP #2

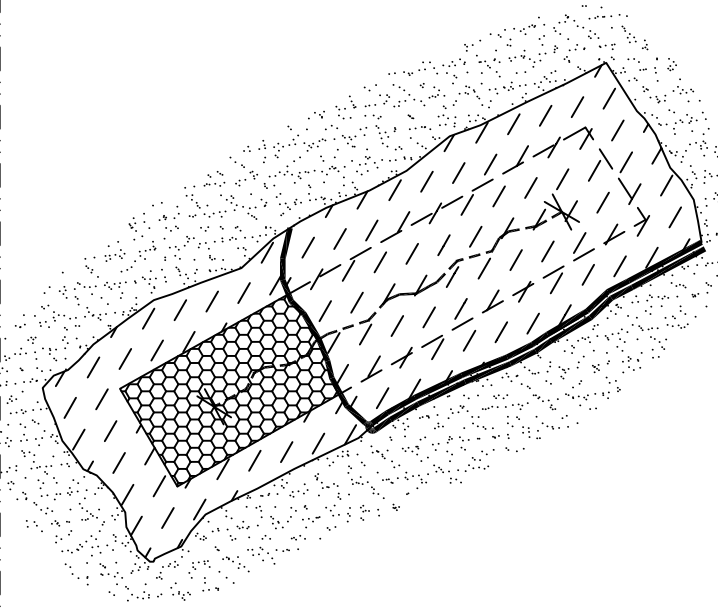

ALSAN FLASHING BASE COAT WITH MIN. 4" (10cm)
WIDE ALSAN PolyFleece REINFORCEMENT EMBEDDED
INTO AND COVERED BY BASE COAT WITHOUT
WRINKLES OR FOLDS. TOTAL WET MILL THICKNESS
30 MILS AND APPROX. 22 DRY MILS (TYP).


STEP #3

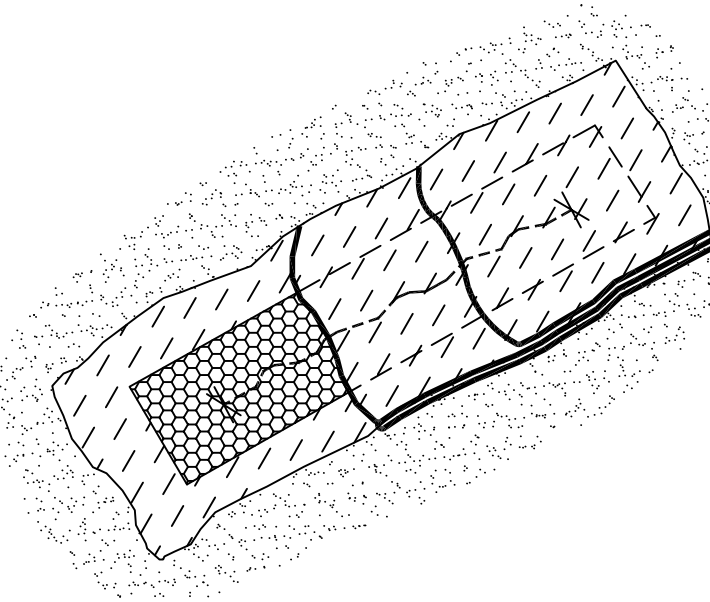

ALSAN FLASHING FINISH COAT - 30 MILS;
OPTIONAL TOP SURFACING OF EMBEDDED
MATCHING GRANULES OR SOPREMA CURAL
ALUMINIZER-24 MILS (16 DRY)

NOTES:

1. DETAIL TO BE USED IN CONJUNCTION WITH SOPREMA GENERAL REQUIREMENTS, APPROVED DETAILS AND ALSAN FLASHING (A.F.) APPLICATION AND COVERAGE DIRECTIONS.
2. CURAL 24 WET MIL COVERAGE RATE (DRY 16 MILS) IS 1.5 GALS/100FT² ALSAN FLASHING 30 WET MILS COVERAGE RATE (22 DRY MILS) IS 1.87 GALS/100FT² ALL COVERAGE RATES ARE APPROXIMATE, THEORETICAL AND DO NOT ACCOUNT FOR WASTE, SPILLAGE, IRREGULAR SURFACES AND APPLICATION TECHNIQUES THAT CAN ALSO VARY WITH INSTALLER. RATES MAY ALSO VARY DEPENDING UPON MATERIAL AND AMBIENT TEMPERATURE(S), SURFACE FINISH AND POROSITY OF THE SUBSTRATE.

		310 QUADRAL DRIVE	
		WADSWORTH, OHIO 44281 (330) 334-0066	
TITLE ALSAN FLASHING BUR SPLIT REPAIR			
SCALE	DWN	CHK	APPROVAL DATE
NONE	DMT	PR	5/1/05
DRAWING NUMBER AFR-001			REV 0

** USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.