



FLASHINGS GREATER THAN 24" (610mm) IN HEIGHT MUST BE FASTENED OFF 8" (203mm) O.C. IN MULTIPLE COURSES OF 24" MAX EACH COURSE; SUBSEQUENT COURSES SHINGLE-IN AND ENCAPSULATE FASTENERS OF PREVIOUSLY FASTENED-OFF FLASHING MEMBRANE COURSE.

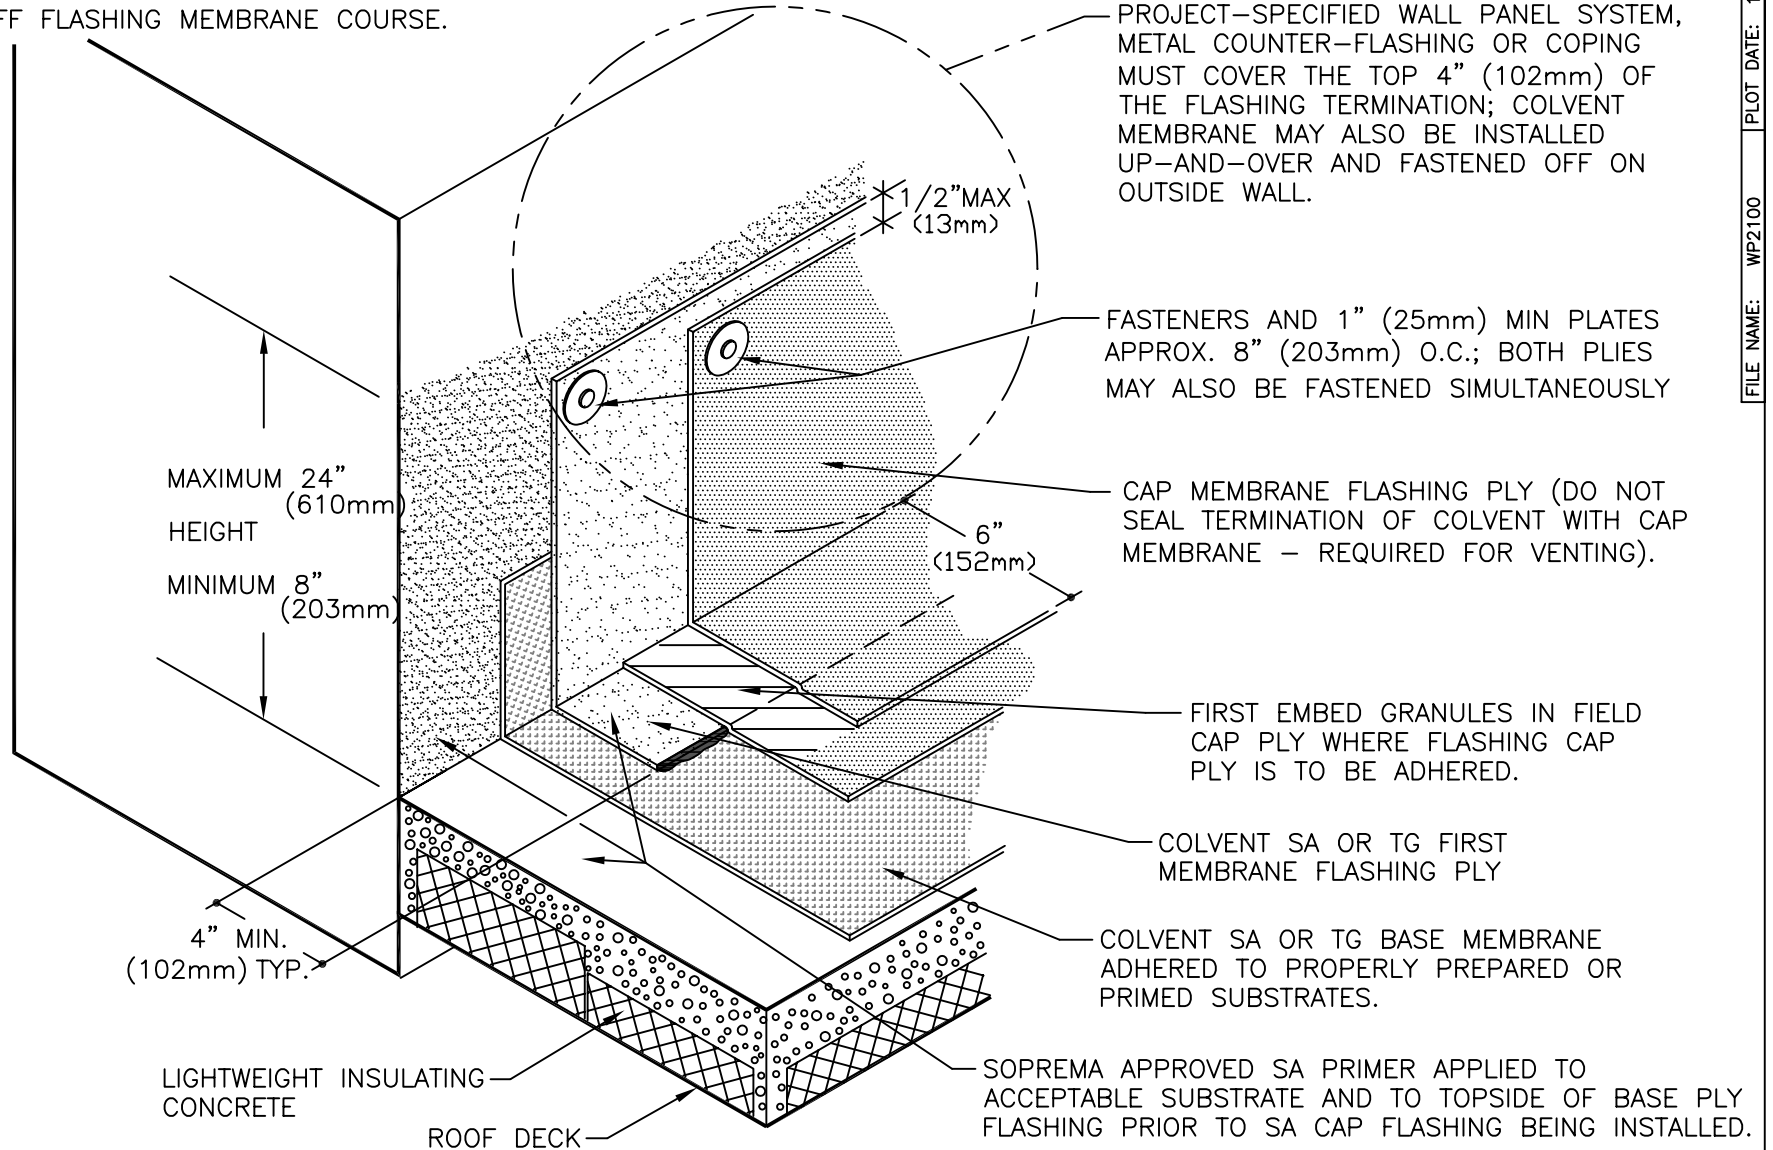

NOTES:

1. USE IN CONJUNCTION WITH SOPREMA GENERAL REQUIREMENTS, COLSTIX PDS AND APPROVED DETAILS WHILE CONSTRUCTING OTHER ROOF COMPONENTS TO EXCEED CURRENT EDITION REQUIREMENTS OF FM APPROVALS, SMACNA, NRCA, ANSI/SPRI ES 1-98 AND FLORIDA BUILDING CODE-RAS NO. 111 WITH THE MOST STRINGENT REQUIREMENTS OR RECOMMENDATIONS PREVAILING.
2. SOPREMA ADHESIVES, CEMENTS, MASTICS, PRIMERS AND SEALANTS ARE REQUIRED WHERE INDICATED.
3. SEE DETAILS CXM-001, 002 & 003 FOR: WATERTIGHT SEAMS @ END LAPS; (T) JOINTS AND OTHER MEMBRANE CONNECTIONS; APPLY SEAM SEALANT AT ALL FINISHED EDGES ON FIELD & FLASHING BASE PLIES, BUT DO NOT SEAL COUNTER-FLASHED TERMINATIONS (REQUIRED FOR VENTING).

		310 QUADRAL DRIVE	
		WADSWORTH, OHIO 44281	
		(330) 334-0066	
TITLE VENTING COLSTIX™ WALL BASE FLASHING W/OUT CANT			
SCALE	DWN	CHK	APPROVAL DATE
NONE	DMT	BS	12/11/07
DRAWING NUMBER			REV
CXWBF-005			0

\*\* USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.

FILE NAME: WP2100 PLOT DATE: 12/11/07