



STEP NO. 1: IDENTIFY EXISTING CAP SHEET MEMBRANE FLASHING PLY W/ UN-ADHERED AREA

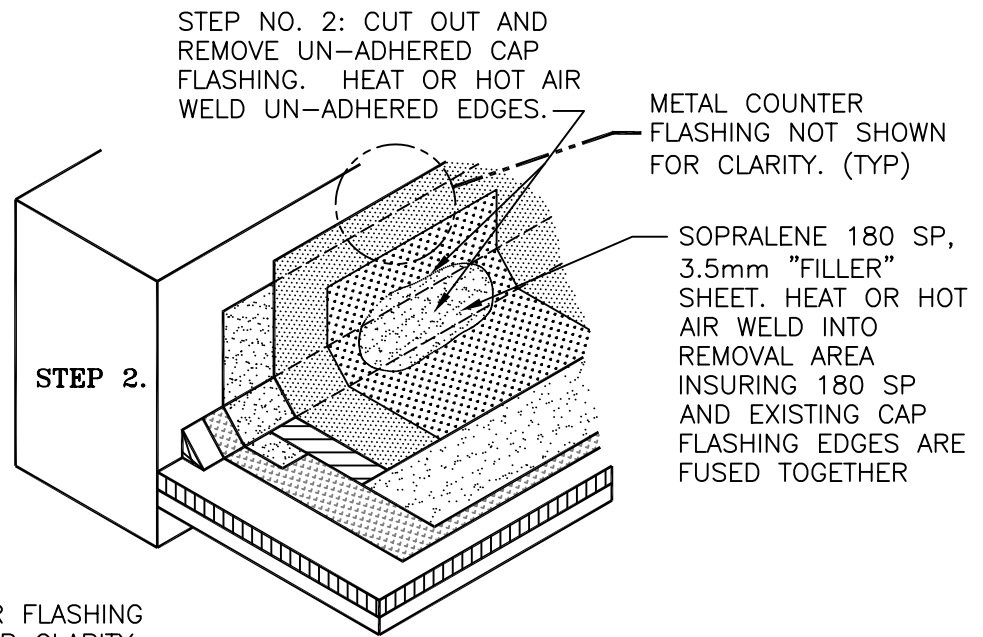

STEP NO. 2: CUT OUT AND REMOVE UN-ADHERED CAP FLASHING. HEAT OR HOT AIR WELD UN-ADHERED EDGES.

METAL COUNTER FLASHING NOT SHOWN FOR CLARITY. (TYP)

SOPRALENE 180 SP, 3.5mm "FILLER" SHEET. HEAT OR HOT AIR WELD INTO REMOVAL AREA INSURING 180 SP AND EXISTING CAP FLASHING EDGES ARE FUSED TOGETHER

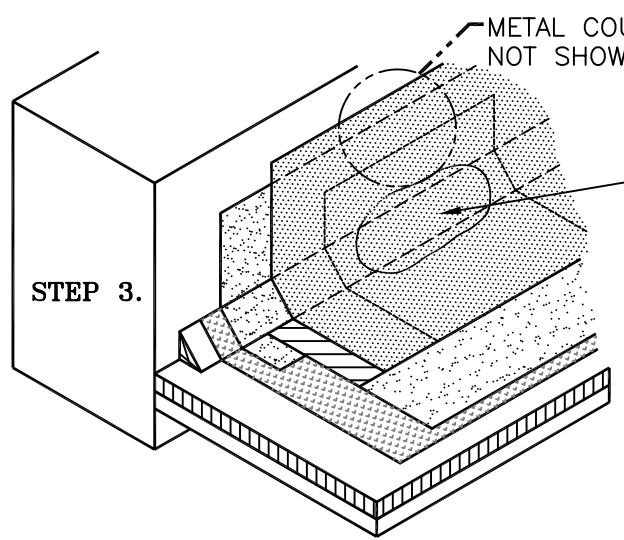


STEP NO. 3: HEAT OR HOT AIR WELD NEW CAP FLASHING SERVICE SPLICE 3" (76mm) BEYOND THE LEFT AND RIGHT SIDE OF THE IDENTIFIED REPAIR AREA EXTEND UP TO THE JUNCTURE OF THE METAL COUNTER FLASHING AND OUT TO THE FIELD TERMINATION POINT. DRESS-UP FINISHED EDGES WITH MATCHING GRANULES.

METAL COUNTER FLASHING NOT SHOWN FOR CLARITY.

NOTES:

1. DETAIL TO BE USE IN CONJUNCTION WITH SOPREMA GENERAL REQUIREMENTS, APPLICATION METHODS AND APPROVED DETAILS.

| | | | |
|---|-----|-----------------------|---------------|
|  | | 310 QUADRAL DRIVE | |
| | | WADSWORTH, OHIO 44281 | |
| | | (330) 334-0066 | |
| TITLE CAP FLASHING MEMBRANE SERVICE SPLICE | | | |
| SCALE | DWN | CHK | APPROVAL DATE |
| NONE | DMT | BS | 12/1/06 |
| DRAWING NUMBER | | | REV |
| MISC-013 | | | 0 |

** USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.