



4 SOPRAFIX FASTENERS ON EACH DRAIN SIDE OF SOPRAFIX MEMBRANE

POLYESTER REINFORCING MEMBRANE PLY

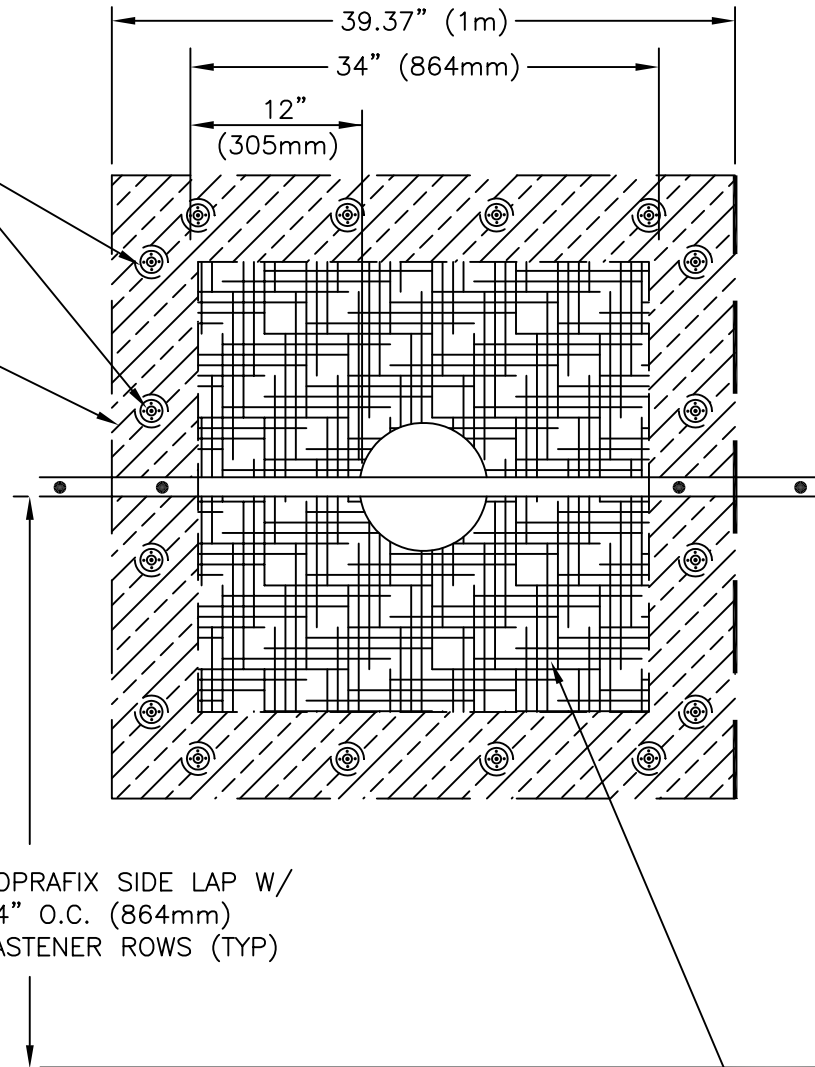

SOPRAFIX SIDE LAP W/
34" O.C. (864mm)
FASTENER ROWS (TYP)


FIELD BASE MEMBRANE PLIES SET IN MIN. 6"
(152mm) WIDE DIA. BED OF SOPREMA
MASTIC-SEALING TO DRAIN FLANGE
(BURN-OFF PLASTIC FILM IF PRESENT)

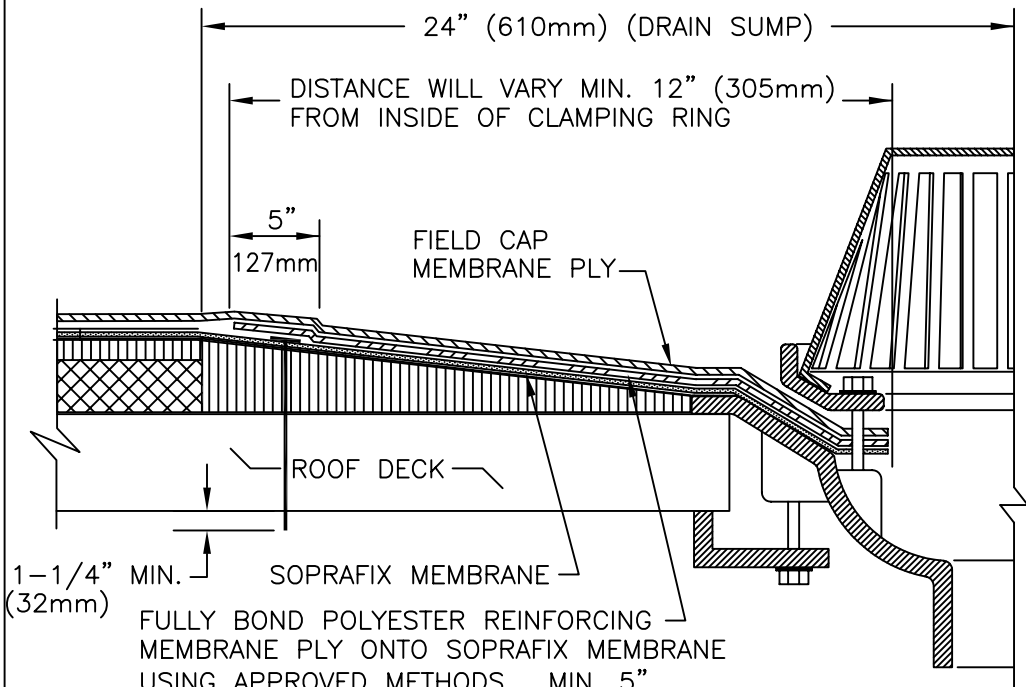

24" (610mm) (DRAIN SUMP)
DISTANCE WILL VARY MIN. 12" (305mm)
FROM INSIDE OF CLAMPING RING
5"
127mm
FIELD CAP
MEMBRANE PLY
ROOF DECK
1-1/4" MIN.
(32mm) SOPRAFIX MEMBRANE
FULLY BOND POLYESTER REINFORCING
MEMBRANE PLY ONTO SOPRAFIX MEMBRANE
USING APPROVED METHODS. MIN. 5"
(127mm) WIDE FINAL EDGE SEAL IS EITHER
HEAT OR HOT AIR WELDED OR SEALED WITH
2-PART ADHESIVE (REMOVE PLASTIC
BURN-OFF FILM IF PRESENT).

NOTES:

1. DETAIL TO BE USED IN CONJUNCTION WITH SOPREMA GENERAL REQUIREMENTS, APPLICATION METHODS AND APPROVED DETAILS.
2. SOPREMA ADHESIVES, CEMENTS, MASTICS, PRIMERS AND SEALANTS ARE REQUIRED WHERE INDICATED.

		310 QUADRAL DRIVE	
		WADSWORTH, OHIO 44281	
		(330) 334-0066	
TITLE SOPRAFIX MEMBRANE DRAIN FLASHING			
SCALE NONE	DWN DMT	CHK PR	APPROVAL DATE 9/1/05
DRAWING NUMBER SFDR-002			REV 0

** USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.