


* LAP SEAM MUST BE ROLLED WITH APPROVED ROLLER.

← MINIMUM 5" (13cm) LAP FULLY WELD AROUND MEMBRANE PLATE; LAP IS HOT AIR WELDED OR UNROLLED AS THE LAP IS BEING HEAT WELDED. SEE NOTE 2. →

← 12" (30.5cm) MINIMUM LAP OFFSET FROM CAP MEMBRANE TO SOPRAFIX MEMBRANE SIDE & END LAPS →

CENTER #14 OR #15 FASTENER W/ SOPRAFIX 2" PLATE IN SIDELAP SEAM. SEE CURRENT SOPRAFIX PDS FOR INSTALLATION PROCEDURES.

SOPREMA SBS FIELD CAP MEMBRANE PLY HEAT WELDED, HOT MOPPED, COLD APPLIED OR COLSTIX™ SELF-ADHERED SEE NOTE 1.

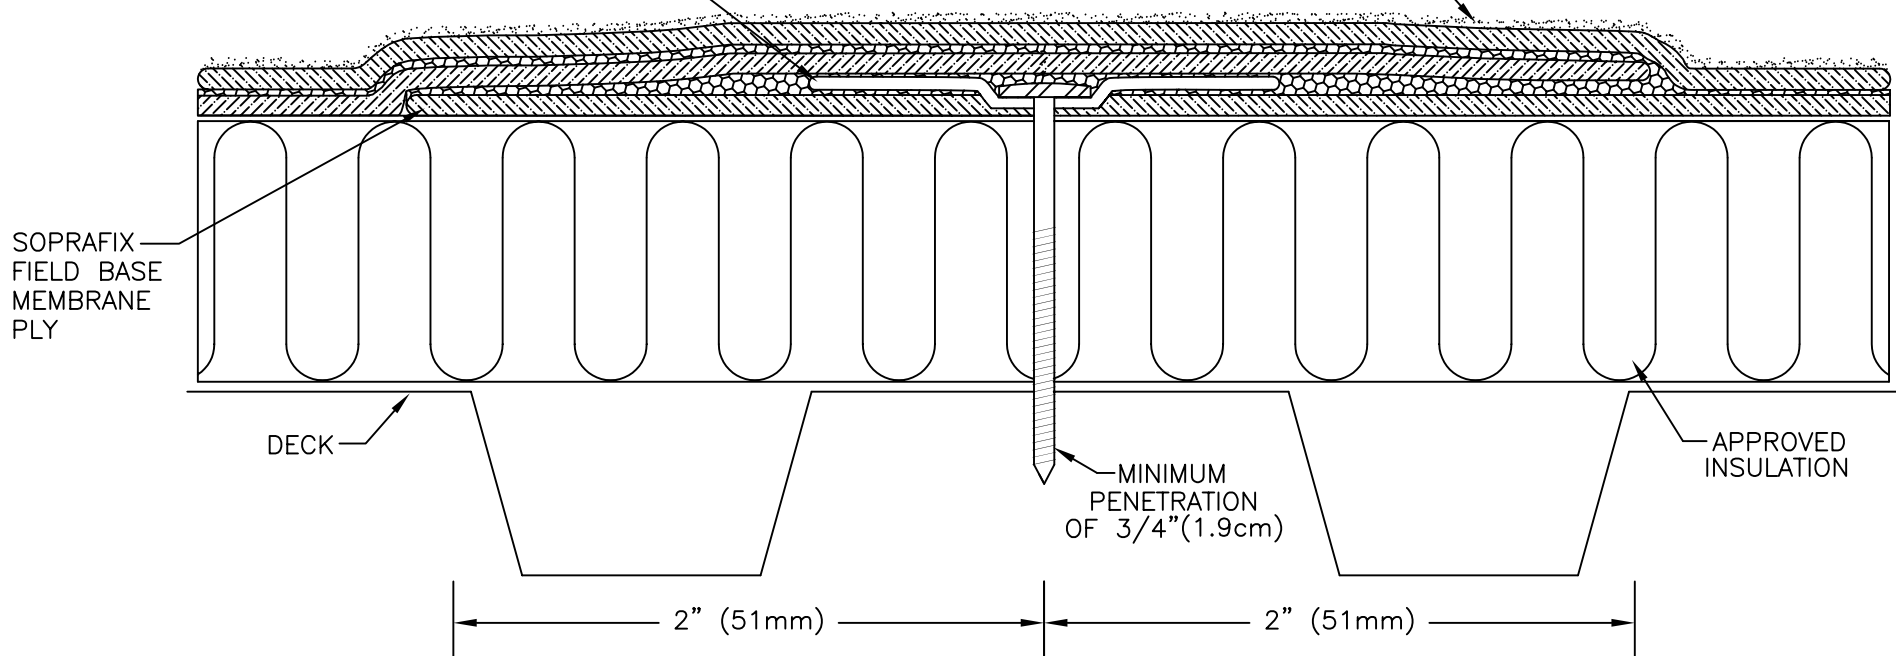


SOPRAFIX FIELD BASE MEMBRANE PLY LAYOUT

SEE FASTENING PATTERN DETAILS: SFMA-003 & SFMA-004

NOTES:

1. DETAIL TO BE USED IN CONJUNCTION WITH SOPREMA GENERAL REQUIREMENTS AND APPROVED DETAILS FOR FM APPROVALS (FMG) APPROVED STEEL & CONCRETE DECKS. **SEE FMG AND ICC/ES LISTINGS FOR APPROVED CONSTRUCTIONS.**
2. FOR WIND RIDERS GREATER THAN 63 MPH @ 3-SEC GUST: ROOFING CONTRACTOR IS RESPONSIBLE TO OBTAIN FROM SOPREMA'S CORPORATE TECHNICAL DEPARTMENT PRIOR TO BIDDING OR JOB-START, APPROVED FASTENING PATTERNS (FASTENER WITHDRAWAL VALUES CAN CHANGE ACTUAL FASTENER SPACING APPROVED) AND THE NUMBER OF REQUIRED PERIMETER ROLLS. IF APPROVAL IS NOT OBTAINED PRIOR TO INSTALLATION, THE COST OF INSTALLING ADDITIONAL FASTENERS WILL BE BORNE BY THE RESPONSIBLE PARTY.
3. PERIMETER DEFINITION: X=4/10 OF BUILDING HEIGHT OR 1/10 THE BUILDING WIDTH, WHICHEVER IS THE LESSER DIMENSION, WITH A MINIMUM OF 2 PERIMETER ROLLS. THE NUMBER OF PERIMETER ROLLS AND **FASTENER DENSITIES MAY INCREASE WHEN WIND WARRANTY RIDERS ARE APPROVED.**
4. SOPRAFIX 2-3/8" PLATE CAN BE SUBSTITUTED FOR THE SOPRAFIX 2" PLATE

		310 QUADRAL DRIVE	
		WADSWORTH, OHIO 44281 (330) 334-0066	
TITLE Basic Soprafix w/2" Plate & 4" Lap			
SCALE NONE	DWN DMT	CHK BS	APPROVAL DATE 2/1/07
DRAWING NUMBER SFMA-001			REV 0

** USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.