




FOR ASPHALT APPLIED MEMBRANE, TAKE CAUTION WITH ASPHALT GETTING ONTO THE SOPRASTAR

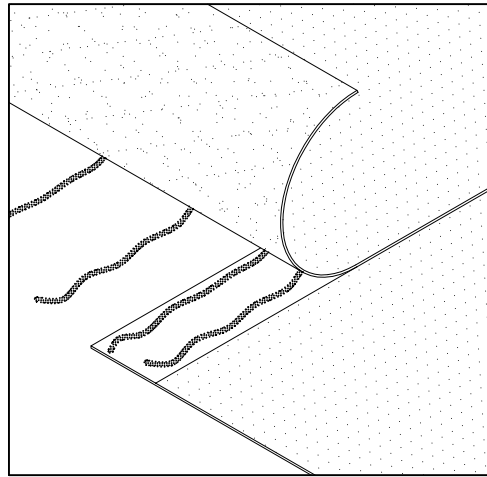


FOR RIBBON APPLIED ADHESIVES, APPLY ADHESIVE RIBBONS ONTO THE LAP

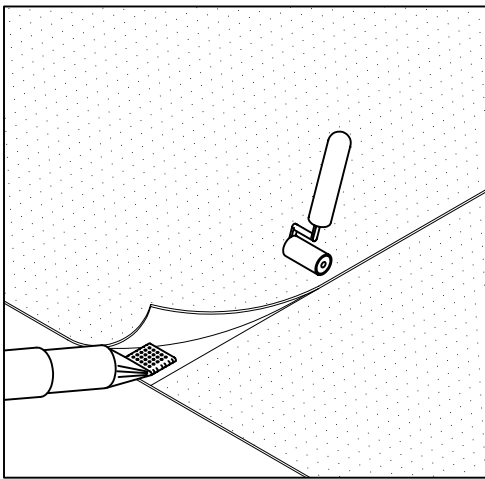

FOR ANY SYSTEM, THE SEAMS MAY BE HEAT WELDED. THIS WILL OFFER THE CLEANEST LAP

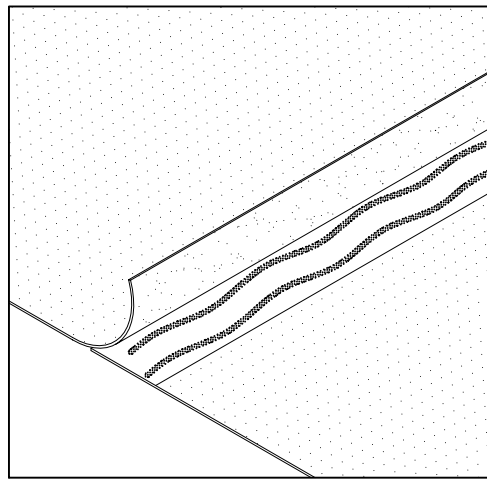


FOR ANY SYSTEM, ADHESIVE RIBBONS MAY BE APPLIED ONTO THE LAP TO CREATE A WATER TIGHT SEAM

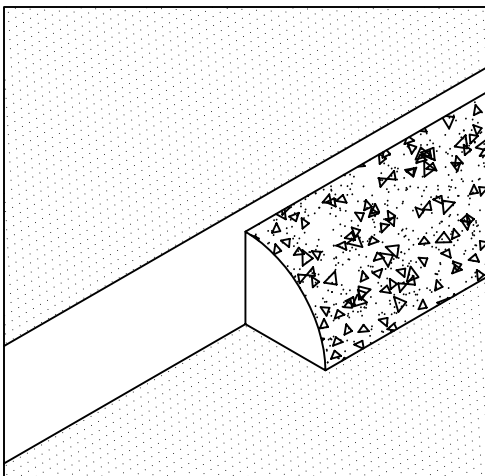

UPON COMPLETION OF THE SEAM, A SOPRASTAR CHIPS MAY BE APPLIED TO THE EXCESS LAP SEALANT OR BLEED-OUT.

NOTES:

1. DETAIL TO BE USE IN CONJUNCTION WITH SOPREMA GENERAL REQUIREMENTS, APPLICATION METHODS AND APPROVED DETAILS.
2. SOPREMA ADHESIVES, CEMENTS, MASTICS, PRIMERS AND SEALANTS ARE REQUIRED WHERE INDICATED.
3. WHEN A PROJECT SPECIFICATION REQUIRES SOPREMA TO WARRANT SHOP FORMED METAL(S), ROOFING CONTRACTOR MUST SUBMIT METAL SPECIFICATION AND ALL PROPOSED METAL DETAILS TO THE SOPREMA CORPORATE TECHNICAL DEPARTMENT FOR REVIEW/APPROVAL PRIOR TO BIDDING AND/OR INSTALLATION.

		310 QUADRAL DRIVE	
		WADSWORTH, OHIO 44281 (330) 334-0066	
TITLE SOPRASTAR LAP TREATMENT			
SCALE	NONE	DWN KD	CHK APPROVAL DATE
DRAWING NUMBER SPSTR-005			06.12.09
			REV 1